





2008 Adequacy of Dialysis Goals

a. Hemodialysis –

- All patients measured for adequacy every month
- $\geq 95\%$ of hemodialysis patient population achieve $URR \geq 65\%$
- $\geq 95\%$ of hemodialysis patient population achieve Kt/V Daugirdas II ≥ 1.2

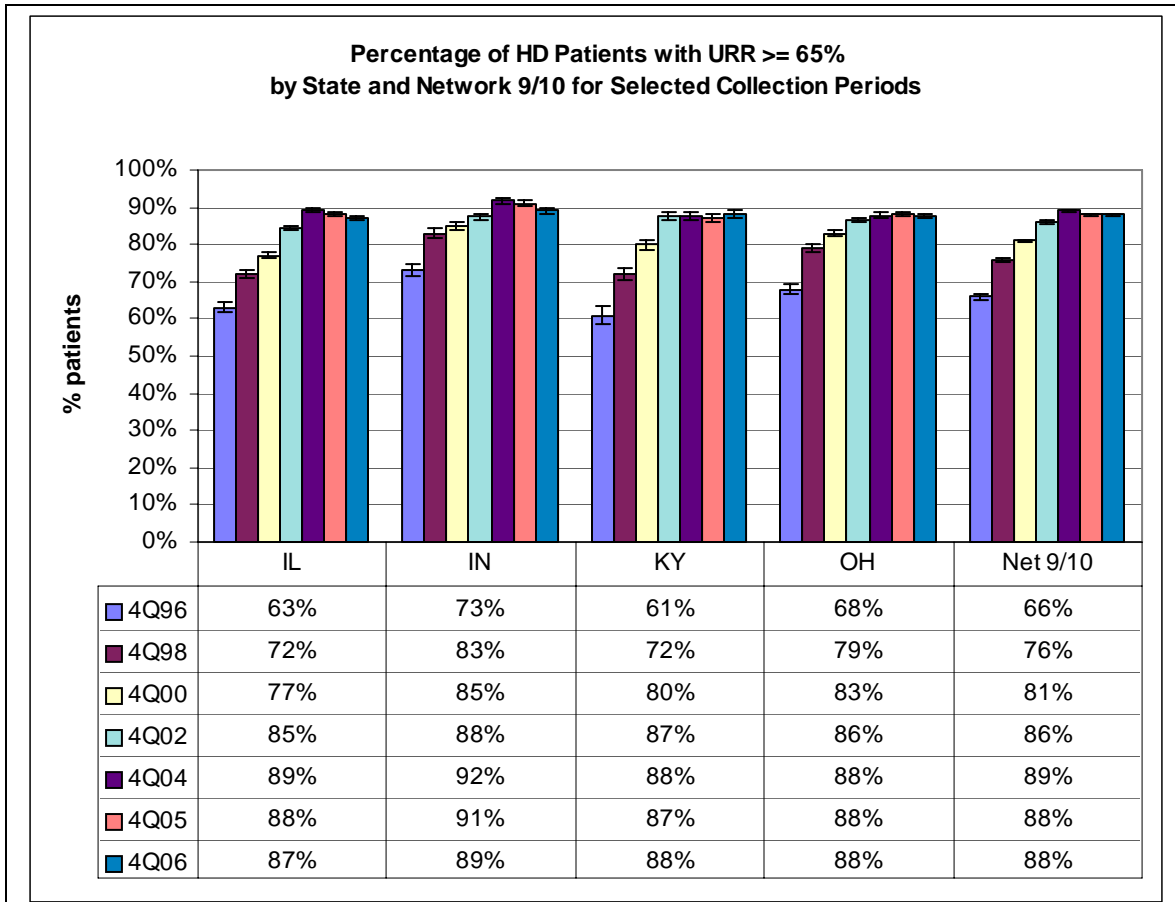

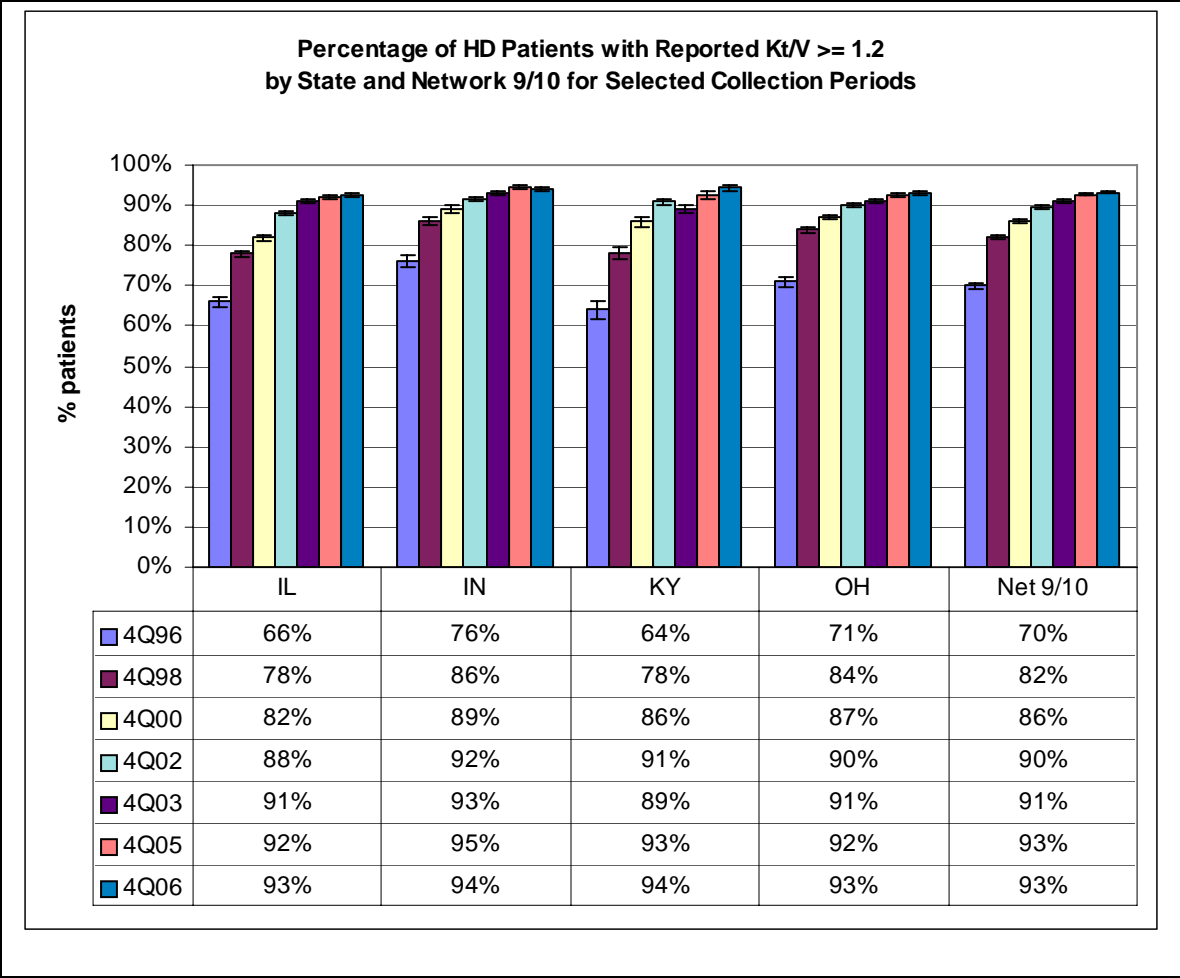

b. Peritoneal Dialysis –

- All patients measured for adequacy every 4 months
- $\geq 85\%$ of peritoneal patient population achieve a weekly $Kt/V_{urea} \geq 1.7$